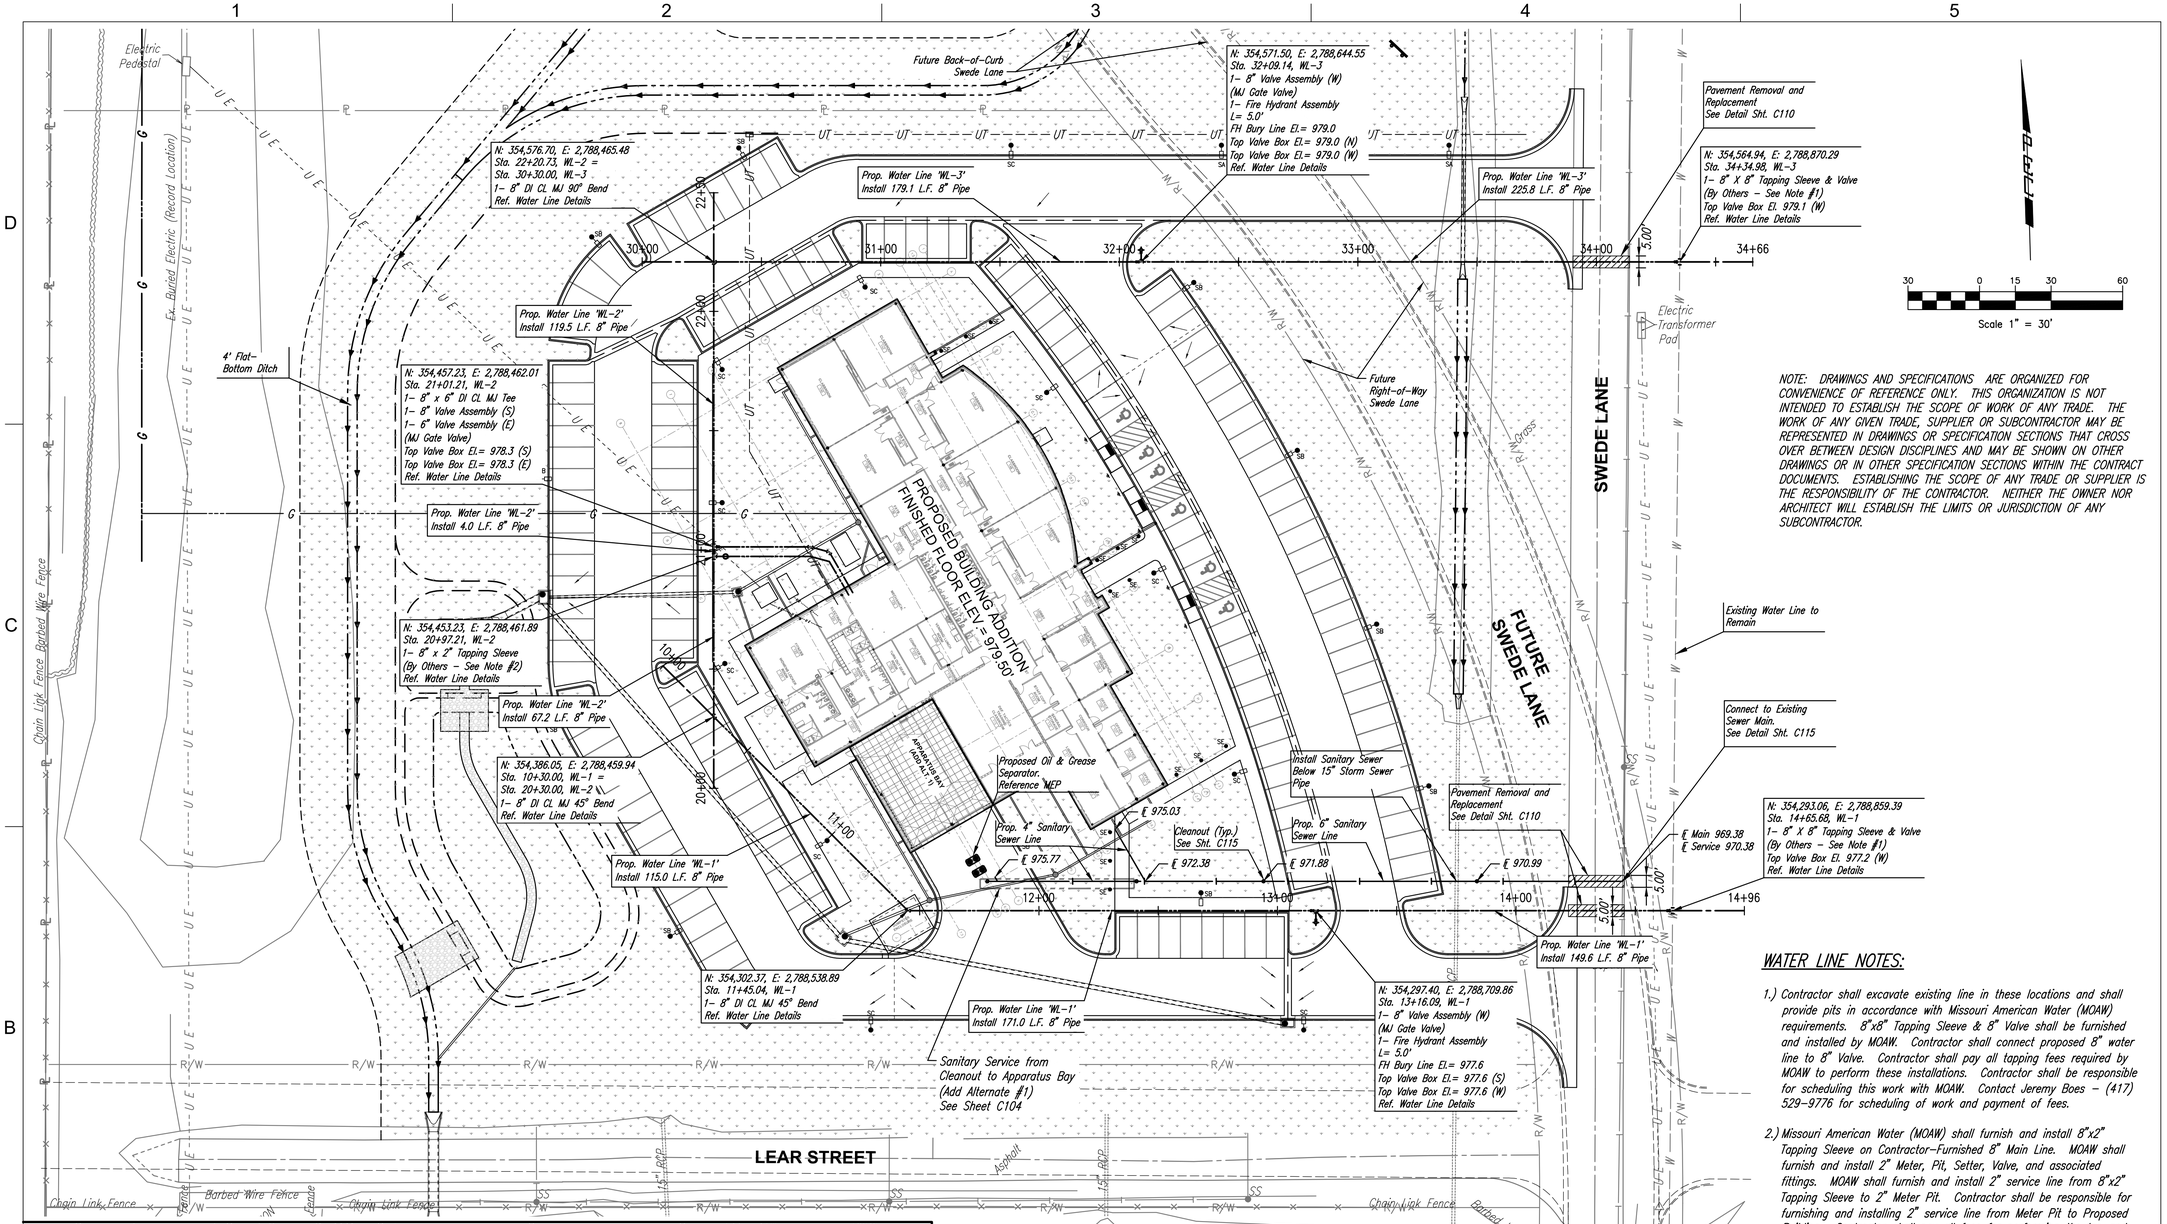

NOTE: DRAWINGS AND SPECIFICATIONS ARE ORGANIZED FOR CONVENIENCE OF REFERENCE ONLY. THIS ORGANIZATION IS NOT INTENDED TO ESTABLISH THE SCOPE OF WORK OF ANY TRADE. THE WORK OF ANY GIVEN TRADE, SUPPLIER OR SUBCONTRACTOR MAY BE REPRESENTED IN DRAWINGS OR SPECIFICATION SECTIONS THAT CROSS OVER BETWEEN DESIGN DISCIPLINES AND MAY BE SHOWN ON OTHER DRAWINGS OR IN OTHER SPECIFICATION SECTIONS WITHIN THE CONTRACT DOCUMENTS. ESTABLISHING THE SCOPE OF ANY TRADE OR SUPPLIER IS THE RESPONSIBILITY OF THE CONTRACTOR. NEITHER THE OWNER NOR ARCHITECT WILL ESTABLISH THE LIMITS OR JURISDICTION OF ANY SUBCONTRACTOR.

WATER LINE NOTES:

1.) Contractor shall excavate existing line in these locations and shall provide pits in accordance with Missouri American Water (MOAW) requirements. 8"x8" Tapping Sleeve & 8" Valve shall be furnished and installed by MOAW. Contractor shall connect proposed 8" water line to 8" Valve. Contractor shall pay all tapping fees required by MOAW to perform these installations. Contractor shall be responsible for scheduling this work with MOAW. Contact Jeremy Boes - (417) 529-9776 for scheduling of work and payment of fees.

2.) Missouri American Water (MOAW) shall furnish and install 8"x2" Tapping Sleeve on Contractor-Furnished 8" Main Line. MOAW shall furnish and install 2" Meter, Pit, Setter, Valve, and associated fittings. MOAW shall furnish and install 2" service line from 8"x2" Tapping Sleeve to 2" Meter Pit. Contractor shall be responsible for furnishing and installing 2" service line from Meter Pit to Proposed Building. Contractor shall pay all fees for performing the tap and furnishing and installing the meter as required by MOAW. Contractor shall be responsible for scheduling this work with MOAW. Contact Jeremy Boes - (417) 529-9776 for scheduling of work and payment of fees.

3.) Contractor shall be responsible for testing, inspection, cleaning, and flushing of proposed water infrastructure in accordance with the plans and specifications. Additionally, the Contractor shall assist with sampling as required by MOAW. Contractor shall pay all fees associated with sampling and testing required by MOAW, and Contractor shall be responsible for coordination and scheduling of this work. Contact Jeremy Boes - (417) 529-9776.

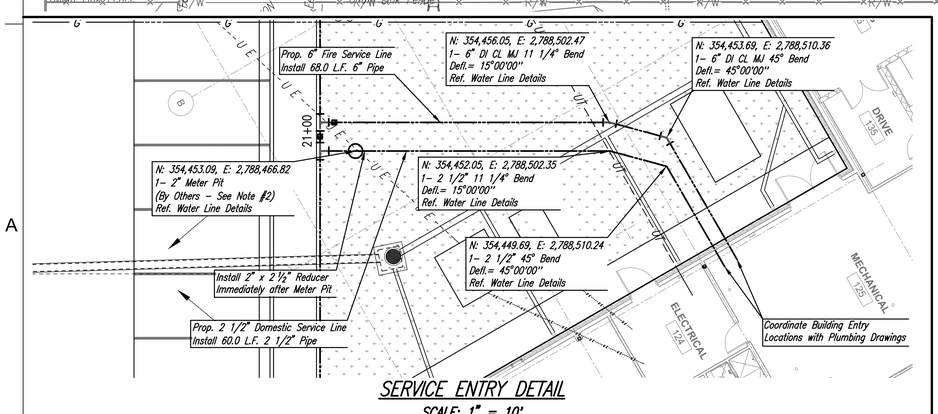

SERVICE ENTRY DETAIL

SCALE: 1" = 10'

GLMV Architecture
9229 Ward Parkway, Ste. 210
Kansas City, MO 64114
Tel: (816) 444-4200
www.glmv.com

PEC
PROFESSIONAL ENGINEERING CONSULTANTS, P.A.
104 SOUTH PINE PITTSBURG, KS 66762
620-235-0195 www.pec1.com
STATE CERT. OF AUTHORITY NO. 000465
PEC PROJECT # 14E14-000

STATE OF MISSOURI
BRIAN COOMES
02/12/2016
NUMBER PE-2015029306
PROFESSIONAL ENGINEER

CONSTRUCTION DOCUMENTS

© 2016 GLMV Architecture, Inc.
All work herein is the exclusive property of GLMV Architecture, Inc. and is not to be copied or used in any way without the express written consent of GLMV Architecture, Inc. All drawings, specification, ideas, designs and arrangements appearing herein constitute the original and unpublished Work of: GLMV Architecture, Inc.

JOPLIN PUBLIC SAFETY TRAINING FACILITY

5102 SWEDE LANE, JOPLIN, MO

MARK	DATE	DESCRIPTION

WATER LINE/ SANITARY SEWER PLAN

JOB NO.	13061.000
DATE	02-12-2016
DRAWN	BMC
CHECKED	BDR

C113

DWG. 18 OF 141

CONSTRUCTION DOCUMENTS

Saved: 01-25-2016 2:57:59 PM by BMC
Plot Scale 1:1 02-12-2016 10:17:54 AM by BRIAN COOMES
U:\Pittsburg\2014\14E14\000\Muni\Drawings\Plan Set\14E14-000_C-113_Water-Sani Plan