


GENERAL SIGNAGE NOTES:

1. PROVIDE THE FOLLOWING SIGNS AT ALL INTERIOR ROOMS WITHIN PROJECT EXTENTS, TYP. SIGNS TO BE SUPPLIED, APPLIED AT WALL, NEAR ENTRY DOOR OF ALL ROOMS/ENTRANCES, INCLUDING MULTIPLE SIGNS AT ROOMS WITH MULTIPLE ENTRIES.
2. INSTALL SIGNS (HEIGHTS AND LOCATIONS) AS DIRECTED BY OWNERS' REPRESENTATIVE IN FIELD. SEE EXISTING BUILDING SIGN PLACEMENT FOR REFERENCE.
3. PROVIDE TACTILE EXIT SIGNAGE AT EACH EXIT DOOR COMPLIANT W/ (BC 2012 1011.1) AND ANSI 117.1-2009, CHAPTER 7, SECTION 702. COLOR OF SIGNAGE TO BE SELECTED BY ARCHITECT PRIOR TO FABRICATION FROM MANUFACTURER FULL LINE OF COLORS (12 COLORS MIN).
4. SIGNS SHALL BE ONE PLYE CONSTRUCTION WITH THE EXCEPTION OF APPLIED VINYL LETTERS & CHARACTERS.
5. ALL SIGNAGE SHALL BE ADA/ANSI COMPLIANT.
6. CHARACTERS TO BE CUT VINYL - APPLIED - OR BY THICK COLORED ACRYLIC W/ COLORED MATTE FINISH & POLISHED FINISHED EDGES.
7. CHARACTERS TO BE CUT VINYL - APPLIED - COLOR TO BE SELECTED BY OWNER/ARCHITECT.
8. LETTERS TO BE 3/4" CUT VINYL - APPLIED - FONT & COLOR TO BE SELECTED BY OWNER/ARCHITECT. ROOM DESIGNATION PROVIDED BY OWNER.
9. RAISED BRAILLE CHARACTERS PROVIDED BY SIGN SUPPLIER.
10. SEE FLOOR PLANS & EQUIPMENT SCHEDULES FOR LOCATIONS OF VINYL APPLIED LETTERING.
11. SEE SPECIFICATIONS FOR MORE INFORMATION.

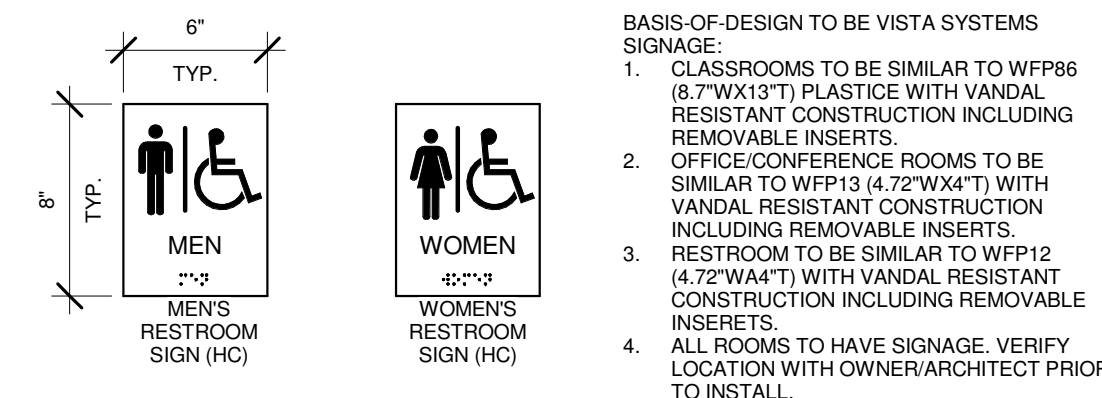

PROVIDE (1) SIGN PER ROOM COMPLYING WITH ADA LOCAL CODE. SIGN TO HAVE RAISED CHARACTERS AND PICTORIAL SYMBOL OF ACCESSIBILITY IN ACCORDANCE WITH ANSI AND ADA GUIDELINES. COLOR TO BE SELECTED BY A.O.R.

RATED FIRE EXTINGUISHER CABINET
SEMI-RECESSED WITH SQUARE TRIM
MOUNTING HEIGHT - T.O. BRACKET SHALL BE 5'-0" AFF
BASIS-OF-DESIGN: LARSEN'S ARCHITECTURAL
SERIES: VERTICAL DUO
MODEL: 2409-R7 WITH EXISTING
MP10 TYPE FIRE EXTINGUISHER
FINISH: ALUMINUM WITH
STANDARD ACRYLIC GLAZING
LETTERING: VERTICAL RED

NOTE:
ALL CONTRACTORS ARE REQUIRED TO PROVIDE A PORTABLE FIRE EXTINGUISHER IN EACH CONSTRUCTION TRAILER, SHED AND SHIPPING CONTAINER LOCATED ON SITE DURING CONSTRUCTION. (IFC 3315.1)

2. EXTERIOR WALL CONSTRUCTION IS DESCRIBED IN WALL SECTIONS. INTERIOR WALLS ARE DESCRIBED BY THEIR DENOTED WALL TYPES / WALL SECTIONS HEREIN.
3. ALL WALLS SHALL BE CONSTRUCTED TO MEET THE REQUIREMENTS OF THE SPECIFICATIONS. THE EXACT WALL TYPE / WALL SECTION TO BE USED SHALL BE CLARIFIED FOR INTERPRETATION BY THE ARCHITECT PRIOR TO BIDDING.
4. WALL SECTIONS SHALL BE CONSTRUCTED TO INCLUDE, BUT NOT BE LIMITED TO, OVERLAP VENEERS, WAINSCOT, PILASTER, PANT, WALL COVERINGS ETC. ARE INDICATED ON FLOOR PLANS, FINISH PLANS, INTERIOR ELEVATIONS, SCHEDULES, SPECIFICATIONS OR OTHER DETAILS.
5. ALL WALLS SHALL BE CONSTRUCTED TO MEET THE REQUIREMENTS OF THE SPECIFICATIONS AND MUST RESIST A MINIMUM DESIGN LOAD OF 50 PSF FIRE RESISTANT GYPSUM BOARD (GOLDBOND BRAND XP GY. BD WITH CALCIUM HYDROXIDE REINFORCED) TO BE INSTALLED PER METAL STUD MANUFACTURERS LIFTING HEIGHT / GAGE INFORMATION. INTERIOR WALL FRAMING TO ACCOMMODATE A LATERAL LOAD SHALL BE PROVIDED PER THE REQUIREMENTS OF THE SPECIFICATIONS.
6. INTERIOR NON-LOAD BEARING WALLS SHALL BE INSTALLED PER METAL STUD MANUFACTURERS LIFTING HEIGHT / GAGE INFORMATION. INTERIOR WALL FRAMING TO ACCOMMODATE A LATERAL LOAD SHALL BE PROVIDED PER THE REQUIREMENTS OF THE SPECIFICATIONS.
7. DESIGN OF LIGHT-GAUGE METAL FRAMING (INCLUDING ALL LOAD BEARING AND NON LOAD BEARING WALLS) AND THEIR CONNECTIONS SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. SUBMITTALS FOR REVIEW OF THE DESIGN SHALL BE PREPARED AND SEALED BY A PROFESSIONAL ENGINEER LICENSED IN THE PROJECT STATE. REVIEW OF SHOP DRAWINGS SHALL BE FOR THE GENERAL SUPERVISOR OF THE PROJECT AND NOT FOR THE ARCHITECT. THE ARCHITECT SHALL REVIEW THE MEMBERS AND THE CONTRACTOR'S INTERPRETATION OF THE DESIGN LOADS AND CONTRACT DOCUMENT DETAILS. SUCH REVIEW SHALL NOT RELIEVE THE CONTRACTOR OF FULL RESPONSIBILITY FOR THE DESIGN AND CONSTRUCTION OF THE MEMBERS.
8. THE CONTRACTOR SHALL COORDINATE WALL FRAMING ABOVE FINISHED CEILINGS WITH FRAMING FOR THE EXISTING HVAC SYSTEMS, MECHANICAL EQUIPMENT, ELECTRICAL EQUIPMENT, ROUGH OPENING FRAMING REQUIRED TO FACILITATE PIPING OR DUCTWORK PENETRATIONS. REFER TO MEP ENGINEERING DRAWINGS FOR LOCATIONS OF LOCATIONS OF NEW / EXISTING DUCTS, PIPING, ETC. PROVIDE FRAMING TO SUPPORT THE EXISTING MECHANICAL EQUIPMENT, ELECTRICAL EQUIPMENT, ROUGH OPENING FRAMING.
9. PROVIDE ELEVATIONS FOR GYPSUM BOARD CONTACT JOINTS AND PROVIDE PER USG GOOD DESIGN PRACTICES (IF CONTROL JOINTS ARE NOT SHOWN) FOR DRYWALL METAL FRAMED SYSTEMS AND DESIGN DETAILS THEREIN.
10. ALL INTERIOR WALLS, PARTITIONS, JANITOR, LOCKER AND SHOWER ROOMS SHALL RECEIVE MOLD, MILDEW AND MOISTURE RESISTANT GYPSUM BOARD, BASIS OF DESIGN 58" FIRE RESISTANT GYPSUM BOARD (GOLDBOND BRAND XP GY. BD WITH CALCIUM HYDROXIDE REINFORCED) TO BE INSTALLED PER METAL STUD MANUFACTURERS LIFTING HEIGHT / GAGE INFORMATION.
11. INTERIOR WALLS SHOULD BE AIRTIGHT. SEAL ALL PENETRATIONS AND CRACKS WITH ACOUSTICAL SEALANT.
12. INTERIOR FIXTURES SUCH AS OUTLETS SHOULD NOT BE PLACED BACK TO BACK IN THE SAME STUD CAVITY.
13. ALL CORRIDOR WALLS TO HAVE A MINIMUM RATING, GASTIGHT NO. WP 1072 AND ASSOCIATED U.S. G.I. REQUIREMENTS SHOULD BE MET FOR ALL CORRIDOR WALLS.

